


Notes:

1. Main disconnect panel may not be used as an electrical race way.
2. Line taps shall be made by the electrical contractor if a galvanized wiring trough is used.
3. Weatherproof fittings required.
4. Any combination of six disconnects totaling no more than 400 amps can be used. REF. NEC, SEC 230.71
5. Recommended wire size is either parallel 2/0 THHN copper or parallel 4/0 THHN aluminum.
6. Neutrals may be reduced no more than two sizes on residential applications. No reduction of the neutrals is allowed on commercial applications.
7. Member shall install an additional of 10' wire for termination.
8. Weatherproof main disconnect panels shall have a single main breaker or 6-handle main as defined in the NEC.
9. Metering point must remain unenclosed on exterior of structure.
10. Metering cannot be mounted on the side of a mobile home.


*** WIRING INSTALLATIONS MUST MEET LOCAL GUIDELINES, IF APPLICABLE, SET FORTH BY CITY, COUNTY, OR OTHER GOVERNING ENTITY IN THE EVENT THESE REQUIREMENTS ARE MORE STRINGENT THAN BLUEBONNET SPECIFICATIONS. ***

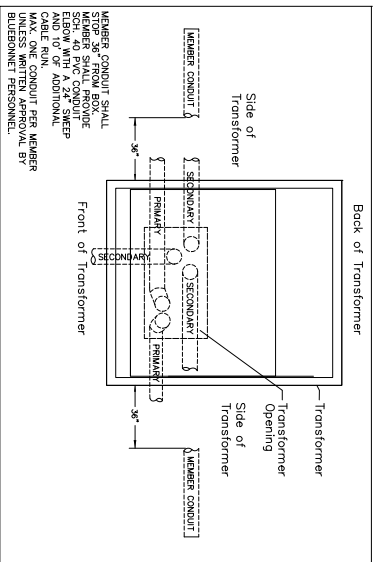

11. All secondary connections in transformer are made by Bluebonnet.
12. Only 400 Amps meter cans are allowed. No 320 Amp Meter Cans are allowed.
13. All service wires entering the meter can (Top or Bottom Feed) will be terminated at the closest lugs. No phase conductors shall be run through the center of the meter can.
14. Member must contact Bluebonnet to determine where the secondary conduit is to be run to the transformer. Conduit to be installed 36" to the side of transformer. Call 800-842-7708 to schedule an appointment.
15. Member/Electrician shall coordinate with Bluebonnet personnel to install all conduit and the pulling of the secondary wire to the transformer.
16. Member/Electrician shall notify Bluebonnet 48 hours in advance to schedule a time/date to perform the work.
17. If additional trips are made to the site by Bluebonnet personnel, applicable fees may be applied.
18. Maintain 3"-6" distance between the disconnect and the meter can. Member shall use a metal nipple. A straight or offset metal nipple is acceptable.
19. Largest wire to be pulled in to the meter can is 500 MCM Cooper. A detailed load sheet shall be filled out and returned to Bluebonnet before the service will be connected.

Latest update can be found at www.bluebonnetelectric.coop/myHome/electricServices/meterLoop.aspx

Landis & Gyr, Type K-4, Description: 400 amp, 4 terminals, 3 wire, residential/commercial socket single phase self-contained, large coverplate. The meter lugs can accommodate up to 500 MCM. These meter cans are available for purchase through Techline or any other electrical supplier provided it meets all Bluebonnet Electric Cooperative specifications. Techline phone numbers: Red Rock (512-332-2978).

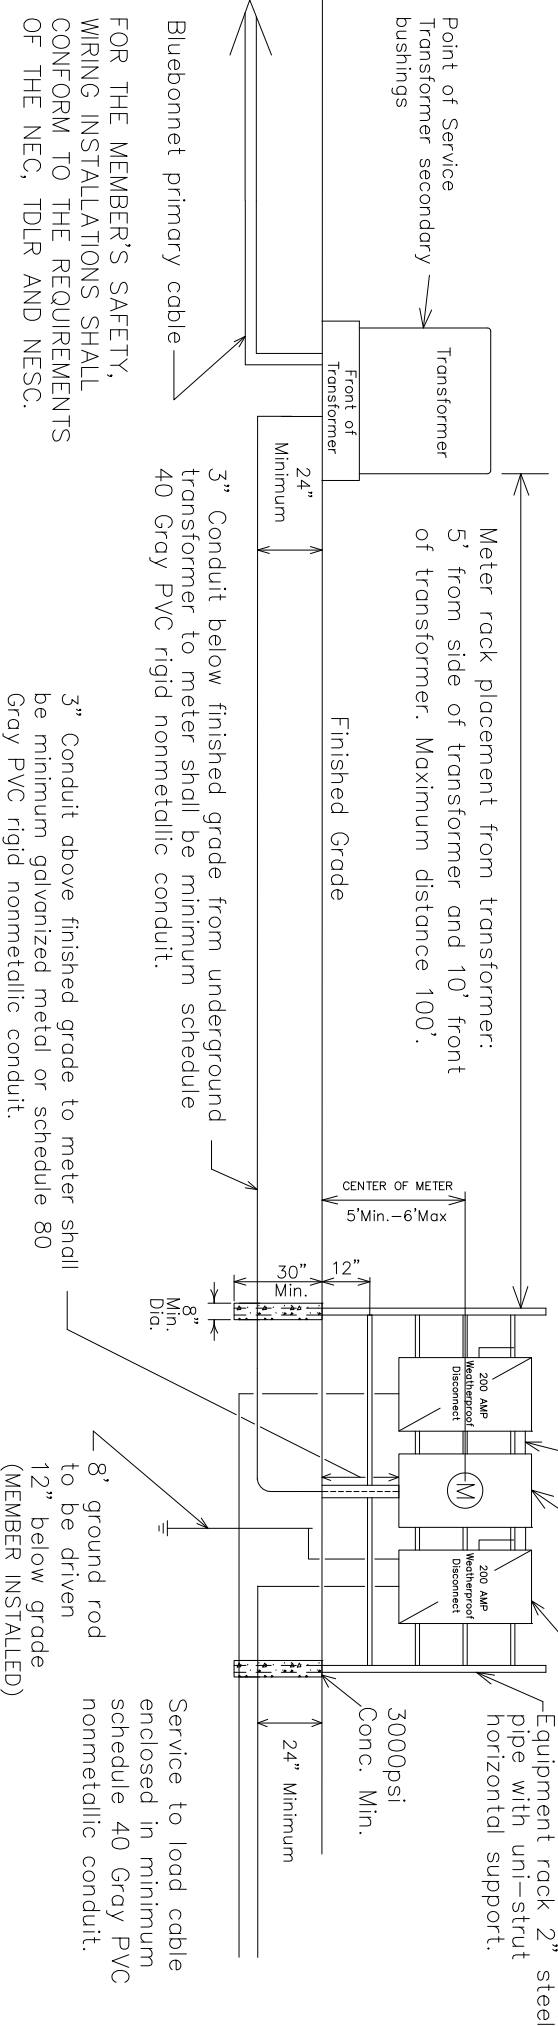

3" Conduit above finished grade to meter shall be minimum galvanized metal or schedule 80 Gray PVC rigid nonmetallic conduit.

Service to load cable enclosed in minimum schedule 40 Gray PVC nonmetallic conduit.

8' ground rod to be driven 12" below grade (MEMBER INSTALLED)

Equipment rack 2" steel pipe with uni-strut horizontal support.

Weatherproof Disconnect(s)

3000psi Conc. Min.

24" Minimum

8" Min. Dia.

12"

5' Min. - 6' Max

CENTER OF METER

24"

Minimum

Point of Service Transformer secondary

Transformer

Front of Transformer

24"

Minimum

Bluebonnet primary cable

3" Conduit below finished grade from underground transformer to meter shall be minimum schedule 40 Gray PVC rigid nonmetallic conduit.

FOR THE MEMBER'S SAFETY, WIRING INSTALLATIONS SHALL CONFORM TO THE REQUIREMENTS OF THE NEC, TDLR AND NESCC.

1Ø 400 AMP URD SERVICE ON RACK OR BUILDING WITH K BASE BOLTED IN METER SOCKET

REVISIONS

DATE

Drawn By: RG

Checked By: MS COMMITTEE

Approved By: TE

Scale: NONE

Date: 08-17-2016

MS-203

