


* WIRING INSTALLATIONS MUST MEET LOCAL GUIDELINES, IF APPLICABLE, SET FORTH BY CITY, COUNTY, OR OTHER GOVERNING ENTITY IN THE EVENT THESE REQUIREMENTS ARE MORE STRINGENT THAN BLUEBONNET SPECIFICATIONS. *

NOTES:

1. Weatherproof fittings required.
2. Wire sized to total disconnect size.
3. Neutral may only be reduced two sizes on residential application. No reduction of the neutral is allowed on commercial application.
4. Meter assembly must remain unenclosed on exterior of structure.
5. Meter assembly cannot be mounted on a mobile home.
6. Member's equipment shall not be attached to Bluebonnet's equipment except for the riser.

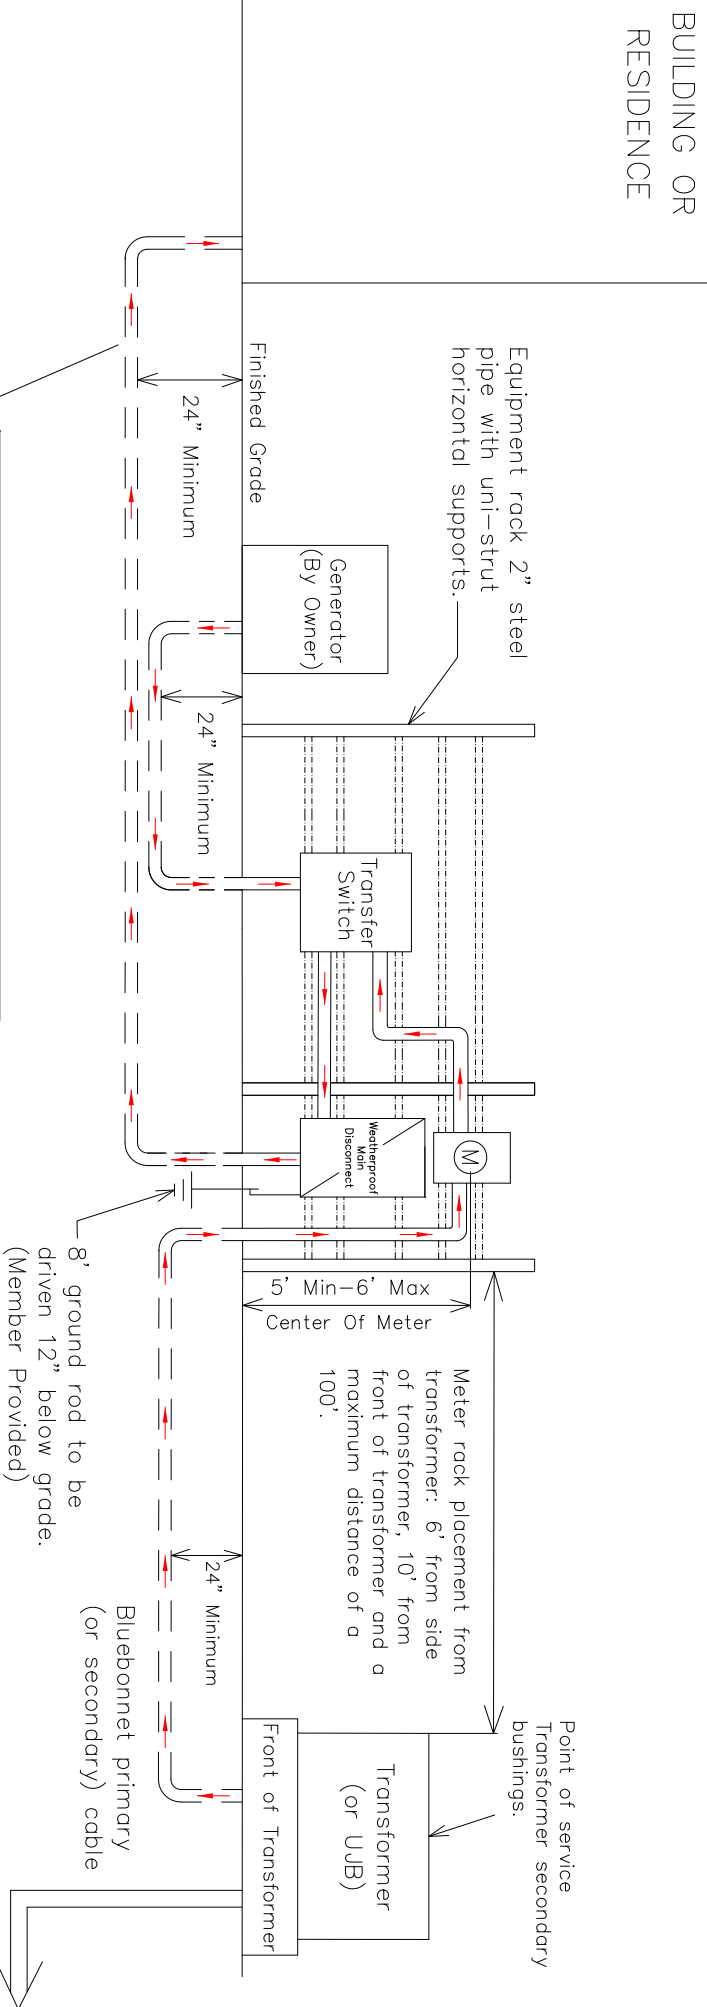

Minimum schedule 40 rigid nonmetallic service conduit below finished grade. No schedule 40 conduit allowed above ground level on source side of main disconnect.

FOR THE MEMBER'S SAFETY, WIRING INSTALLATIONS SHALL CONFORM TO THE REQUIREMENTS OF THE NEC, TDLR AND NESC.

Latest update can be found at www.bluebonnetelectric.coop/myHome/electricServices/meterLoop.aspx

BUILDING OR RESIDENCE



60-200 AMP 1Ø Existing URD SERVICE TO A UNDERGROUND STANDBY GENERATOR SYSTEM WITH METER ON RACK OR BUILDING.		Drawn By :	JW	Checked By :	MS COMMITTEE	Approved By :	TE
DATE	REVISIONS	Scale :	NONE	Date :	11-15-216		MS-408
11-15-2016	ADDED FLOW ARROWS.						